



BETTER SCIENCE. BRILLIANT WATER.[®]

EVOLVE SERIES[®] TWIN CONDITIONER SPECIFICATIONS

| MODEL | EV1-1044TW | EV1-1054TW | EV1-1354TW | EV2-1044TW | EV2-1054TW | EV2-1354TW |
|---------------------------------------|----------------------|---------------|---------------|---------------|---------------|---------------|
| ¹Capacity: (Grains/Lbs. NaCl) | Maximum | 11,800 @ 12.4 | 22,600 @ 15.9 | 36,900 @ 21.2 | 20,300 @ 12.4 | 34,800 @ 15.9 |
| | Medium | 11,400 @ 9.3 | 20,700 @ 12.4 | 33,600 @ 15.9 | 19,100 @ 9.3 | 32,000 @ 12.4 |
| | Minimum | 7,300 @ 3.2 | 16,400 @ 6.1 | 28,300 @ 9.5 | 11,100 @ 3.2 | 22,900 @ 6.1 |
| Amount of Media (Cu. Ft.) | 1.0 | 1.5 | 2.5 | 1.0 | 1.5 | 2.5 |
| Maximum Water Hardness (GPG) | 20 | 30 | 40 | 40 | 60 | 80 |
| ²Maximum Iron and Manganese (PPM) | 8.0 | 10.0 | 15.0 | 8.0 | 10.0 | 15.0 |
| ³Minimum pH | 6.5 | 6.0 | 6.0 | 7.0 | 7.0 | 7.0 |
| ⁴Total pH Adjusted Water | 510 | 510 | 863 | NA | NA | NA |
| ⁵Peak Flow Rate (GPM @ P-PSI) | 19.0 @ 8.3 | 17.0 @ 7.8 | 19.0 @ 7.6 | 19.0 @ 9.3 | 17.0 @ 9.1 | 19.0 @ 8.6 |
| Continuous Flow Rate (GPM @ P-PSI) | 9.0 @ 2.4 | 9.0 @ 2.8 | 9.0 @ 2.7 | 9.0 @ 3.0 | 8.0 @ 3.7 | 9.0 @ 2.8 |
| Water Pressure Range (PSI) | 25-100 | 25-100 | 25-100 | 25-100 | 25-100 | 25-100 |
| Water Temp. (°F) | 33-100 | 33-100 | 33-100 | 33-100 | 33-100 | 33-100 |
| Electrical Requirements (volts-hertz) | 110-50/60 | 110-50/60 | 110-50/60 | 110-50/60 | 110-50/60 | 110-50/60 |
| Pipe Size | 1" | 1" | 1" | 1" | 1" | 1" |
| Total Dimensions: | Media Tank and Valve | 29"W x 52"H | 29"W x 62"H | 31"W x 62"H | 29"W x 52"H | 29"W x 62"H |
| | Brine Tank | 18"W x 33"H | 18"W x 33"H | 18"W x 40"H | 18"W x 33"H | 18"W x 40"H |


^¹ All Evolve water conditioners are pre-factory set at medium salting. Note: influent waters must be at least 3 GPG hardness and 80 TDS. A calcite or corosex unit may be needed for correct operation.

^² Combined iron and manganese removal varies depending on the form of iron, manganese, pH and other local conditions. On waters that are pre-chlorinated or where other pre-oxidation occurs, precipitated metal oxides may form that are too fine to be filtered.

^³ The pH listed is the minimum for the influent water.

^⁴ Optimum pH adjustment occurs at 3.0 gpm or less at maximum salt settings. Higher flow rates will produce less pH adjusted water.

^⁵ Unit not tested for capacity at these flow rates. Water quality may vary.

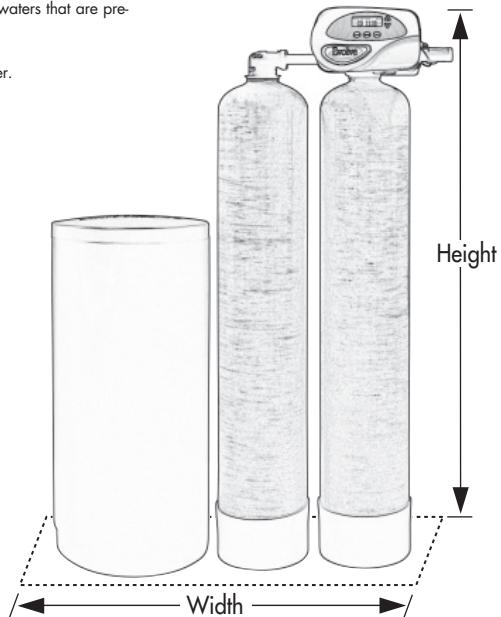

CYCLE TIMES AND USAGE

| MODEL | EV1-1044TW | EV1-1054TW | EV1-1354TW | EV2-1044TW | EV2-1054TW | EV2-1354TW |
|---------------|------------|------------|------------|------------|------------|------------|
| | MIN. GAL. |
| Backwash | 12 | 42 | 12 | 48 | 12 | 36 |
| Brine & Rinse | 72 | 29 | 90 | 36 | 90 | 72 |
| Rapid Rinse | 4 | 14 | 4 | 16 | 4 | 28 |
| Brine Refill | 5.51 | 3 | 9.53 | 5 | 11.53 | 6 |
| Total | 94 | 88 | 116 | 105 | 118 | 158 |